



Appendix F – Conceptual Layout Designs for Various Production Flow Rates

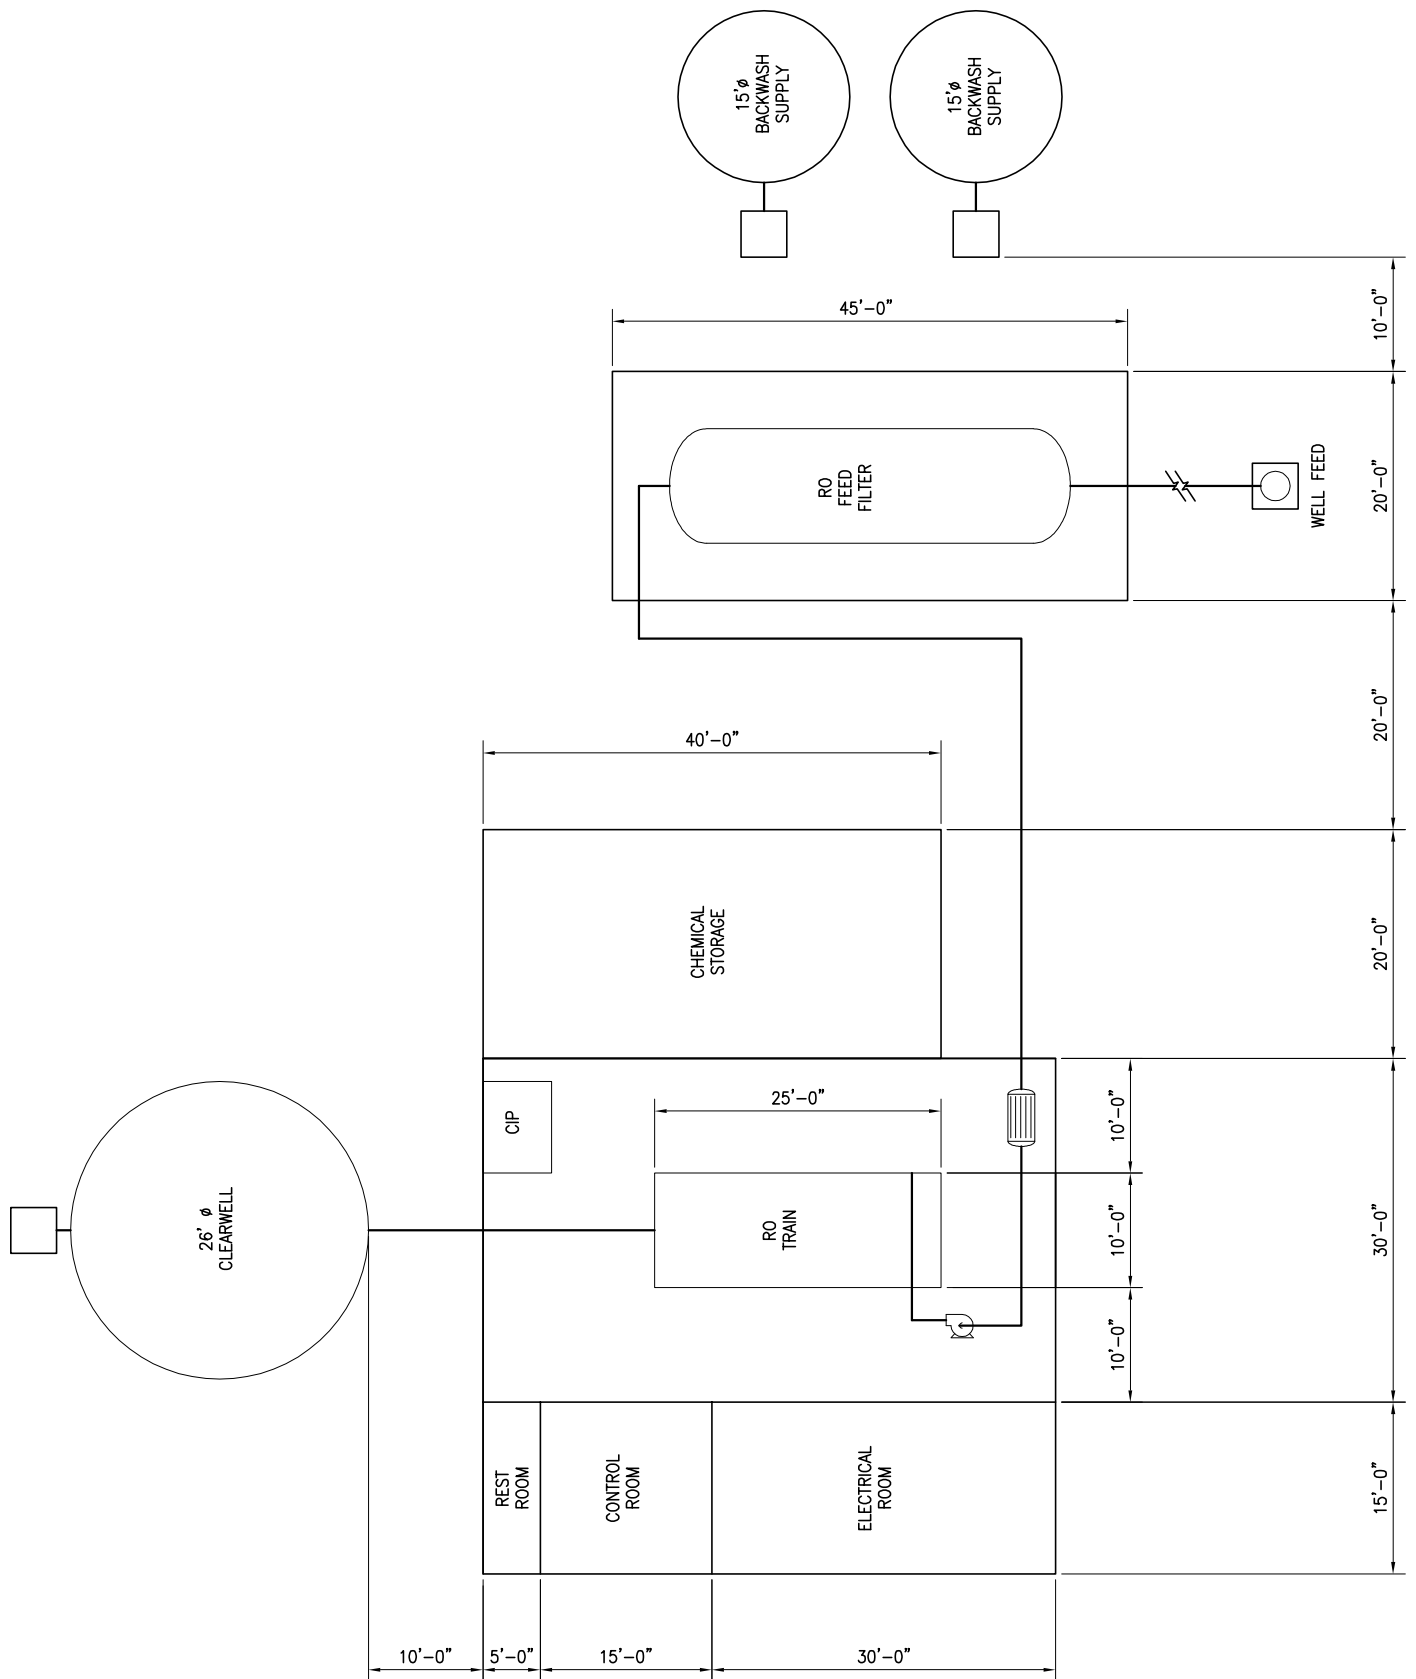

BUENA VISTA WATER STORAGE DISTRICT

FIGURE F-1
1 MGD WTP


BOYLE ENGINEERING CORPORATION

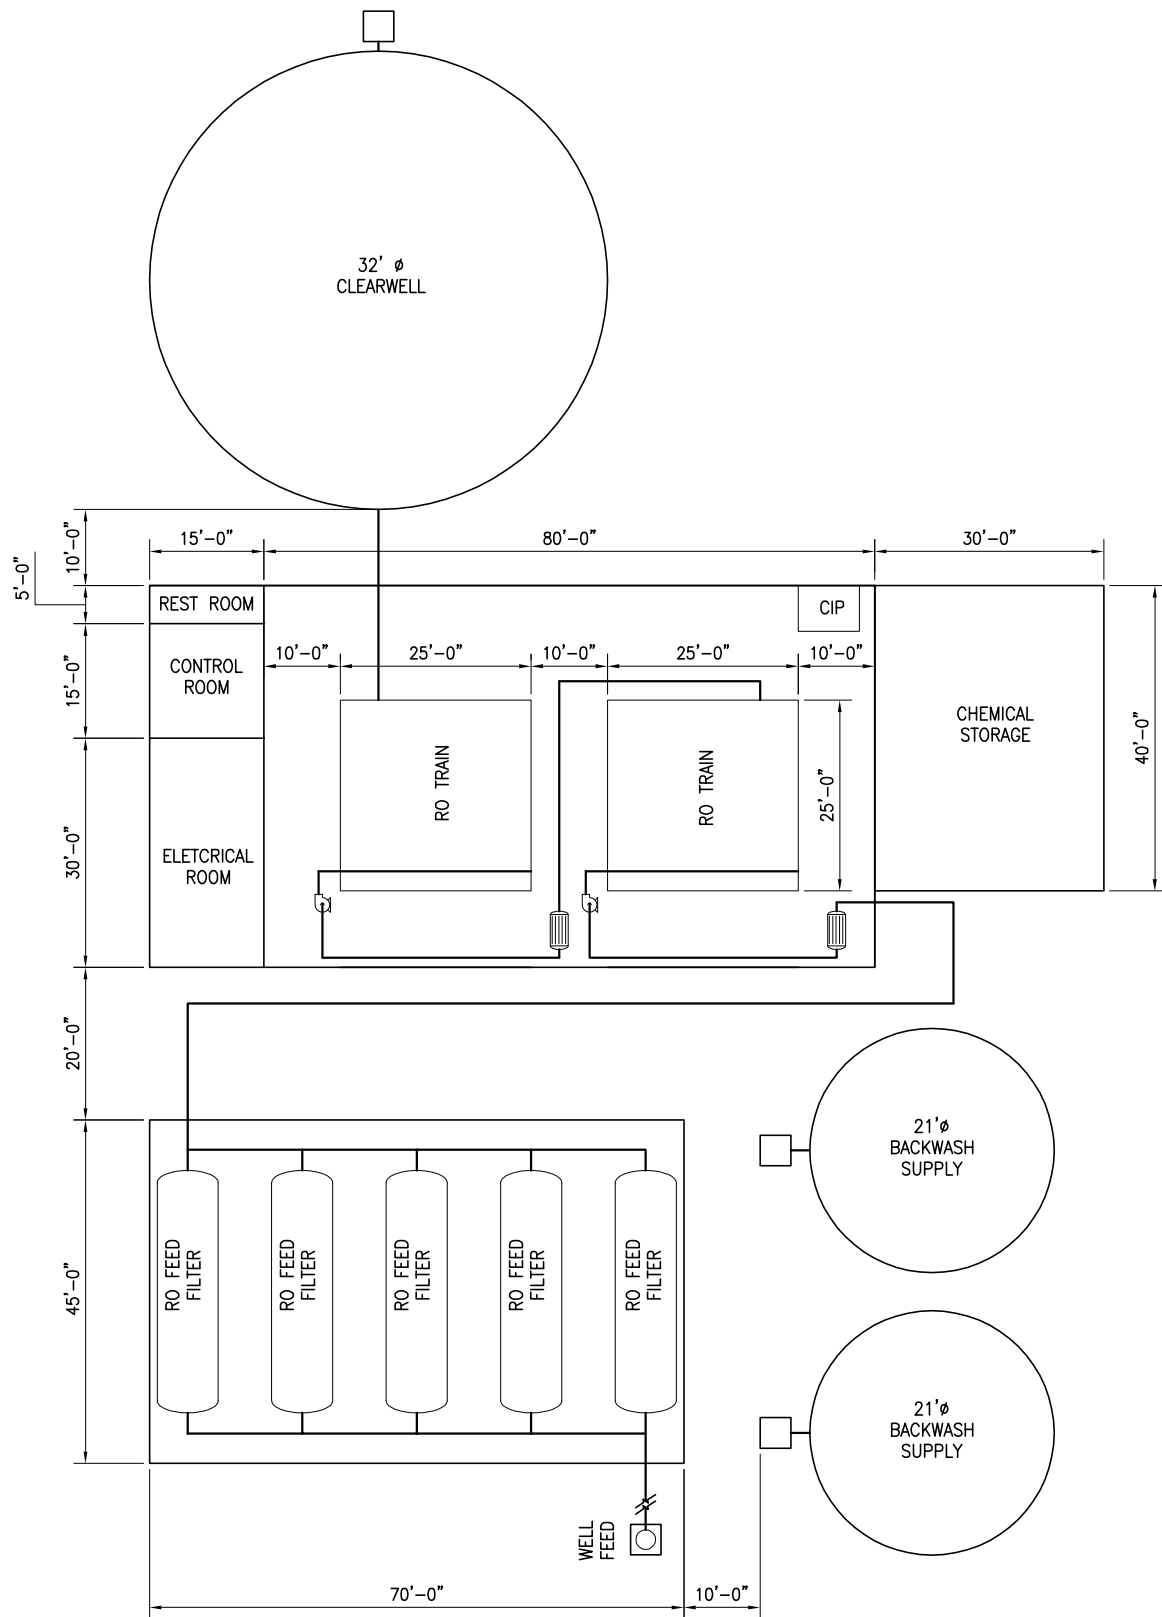

BUENA VISTA WATER STORAGE DISTRICT

**FIGURE F-3
5 MGD WTP**

BOYLE ENGINEERING CORPORATION

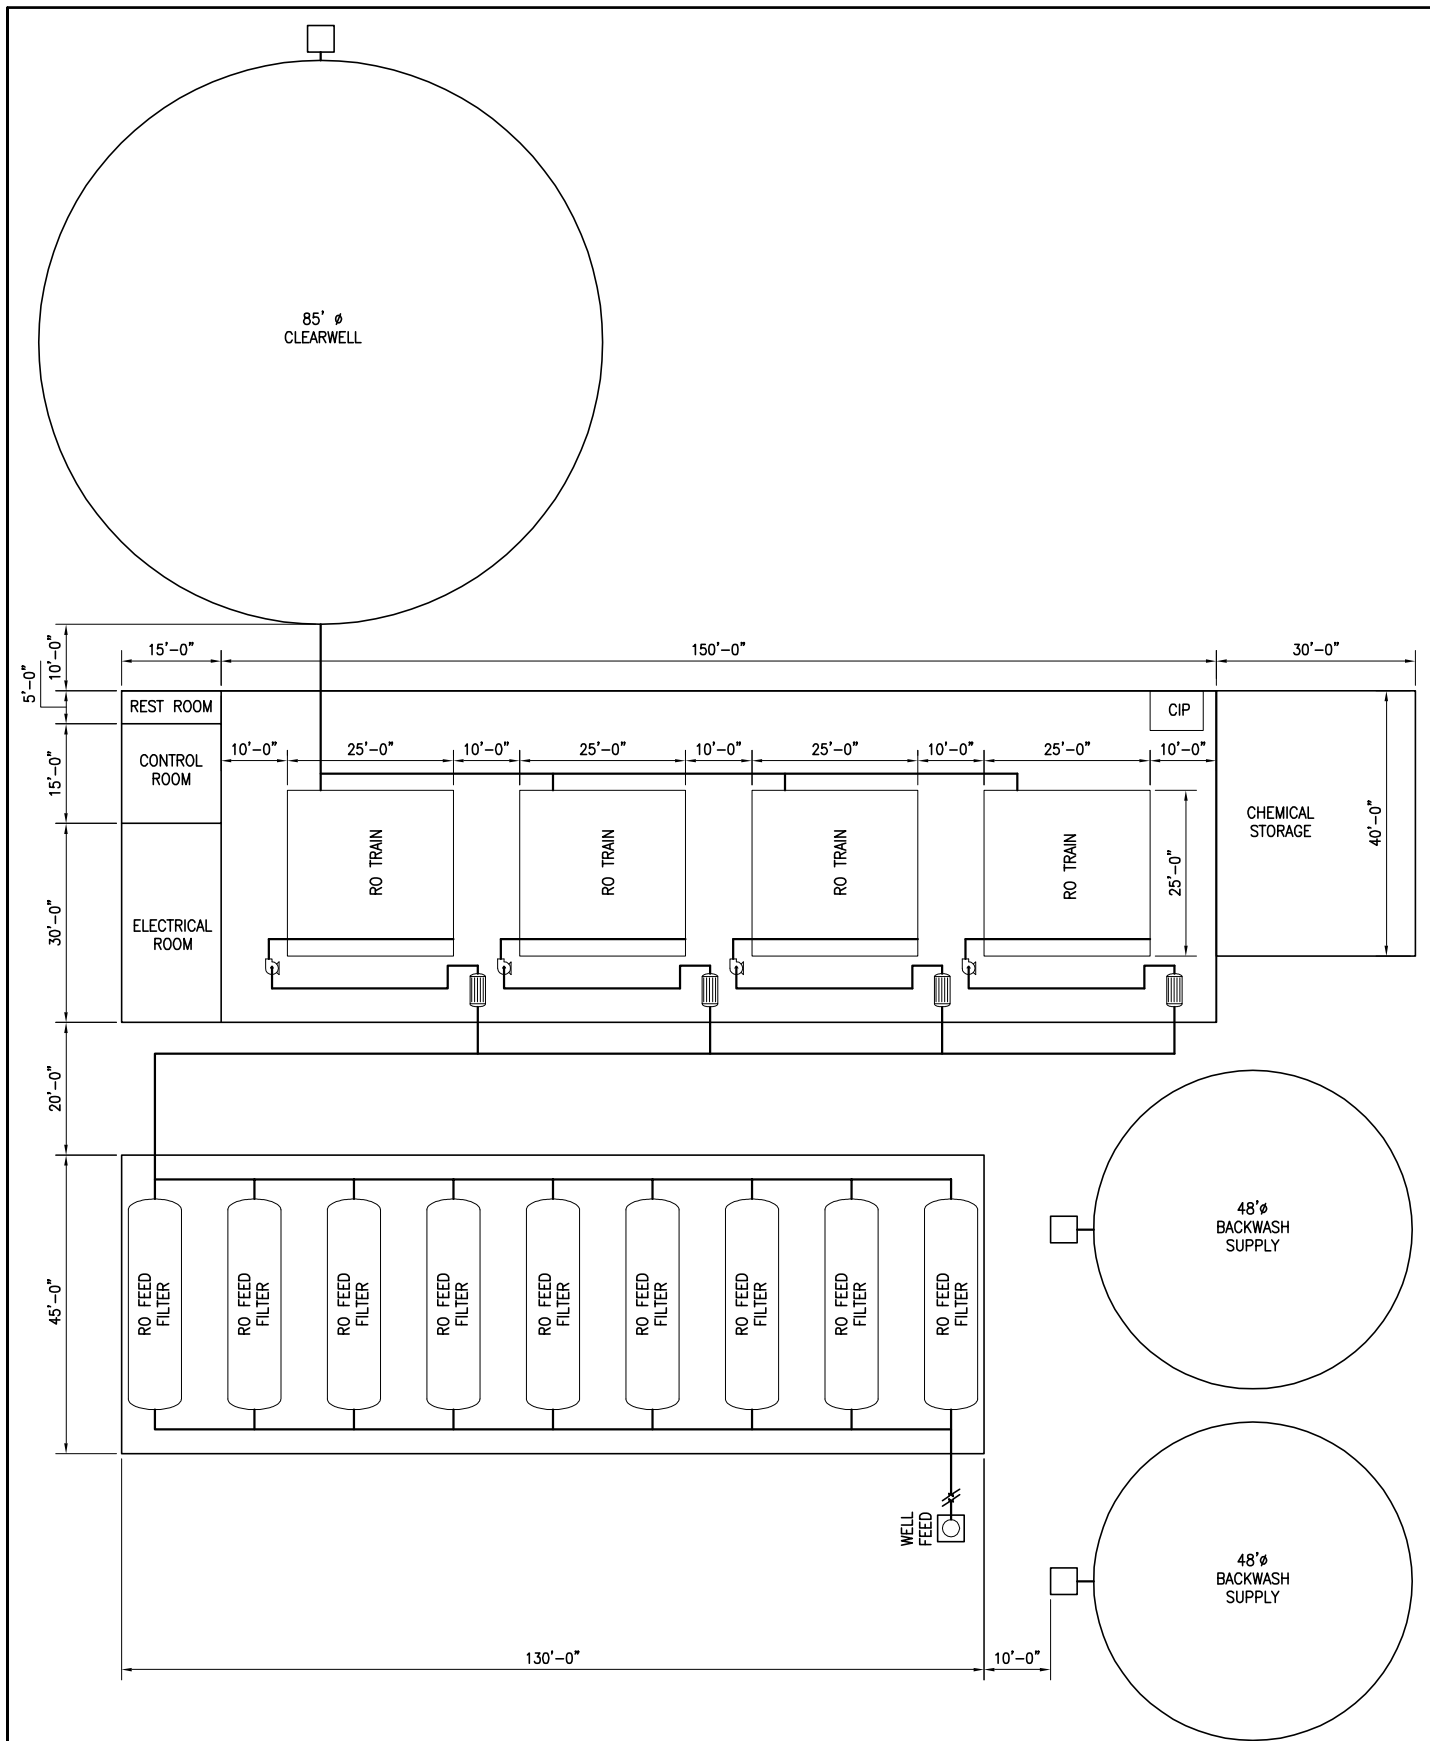

BUENA VISTA WATER STORAGE DISTRICT

FIGURE F-4
10 MGD WTP

BOYLE ENGINEERING CORPORATION